

ABOVE GRADE REINFORCING
 #4 @ 12" o/c VERTICAL
 #4 @ 24" o/c HORIZONTAL

2500 PSI CONCRETE FILL
 (REFER TO DURISOL
 CONSTRUCTION SPECIFICATIONS)

12" (R-20) WALL FORM
 W/ 3" INSULATION
 INSERT

#4 DOWELS @ 36" o/c

MIN 2% GRADE

SLAB ON GRADE

NOTE:
 1. THIS DETAIL IS FOR
 STRUCTURAL REQUIREMENTS OF
 THE DURISOL WALL SYSTEM ONLY.
 ALL OTHER DETAILING
 (STRUCTURAL AND
 ARCHITECTURAL) ARE BY OTHERS

2. MAXIMUM WALL HEIGHT TO BE
 SPECIFIED BY ENGINEER OF
 RECORD.

3. ALL OPENINGS TO BE FRAMED
 WITH ADDITIONAL #4 REBAR

4. ALL LINTEL SIZES AND
 REINFORCING TO BE VERIFIED BY
 AN ENGINEER OR IN ACCORDANCE
 WITH DURISOL LINTEL SCHEDULE


SLAB ON GRADE DESIGN,
 REINFORCING AND
 SPECIFICATIONS BY
 OTHERS

TYPICAL SECTION

TITLE:
 DURISOL FLOOR DETAIL NO. 25

PROJECT:
 DETAILS - DURISOL WALLFORM SYSTEM

DATE: 05.28.03	REVISED:	DRAWN BY: VA	CHECKED BY: VA	FILE NAME: DFL-25
-------------------	----------	-----------------	-------------------	----------------------

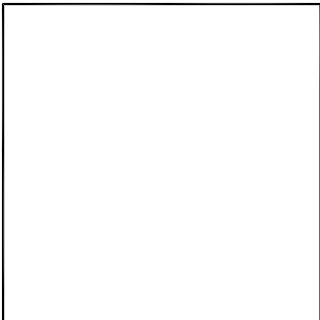

JOB NO:

SCALE:
 1 :10

DWG. NO:
 DFL-25